



## 2025 WATER QUALITY RESULTS

(no bars for AHL030 or BTQ030 are due to lack of water)


Dissolved oxygen:

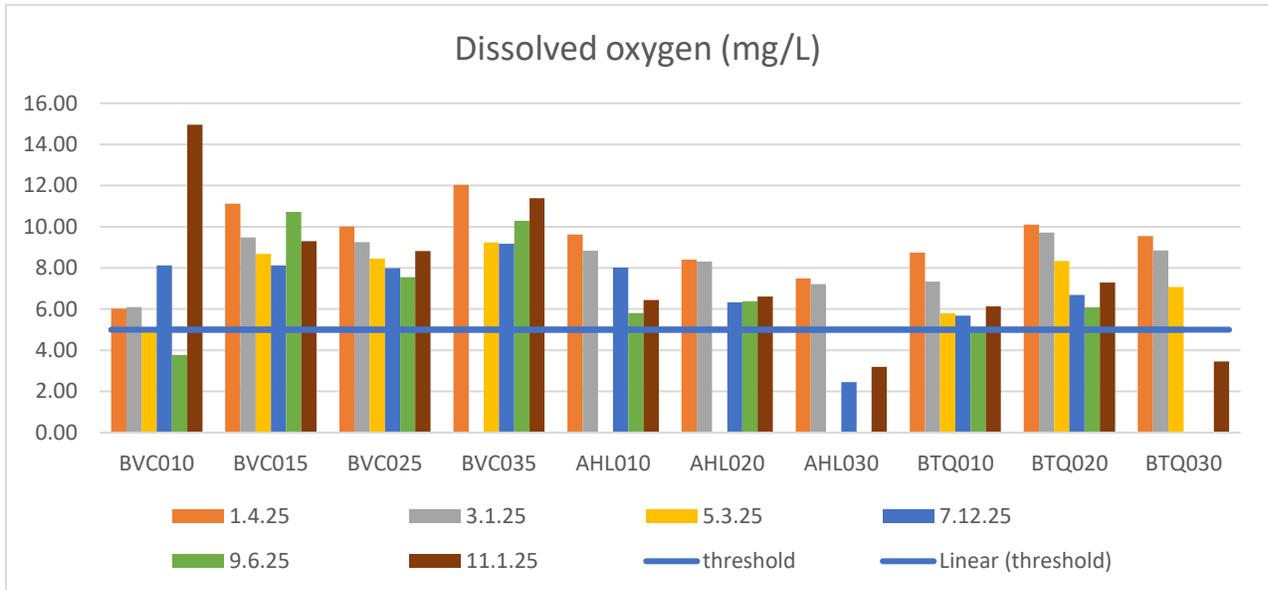


Conductivity:

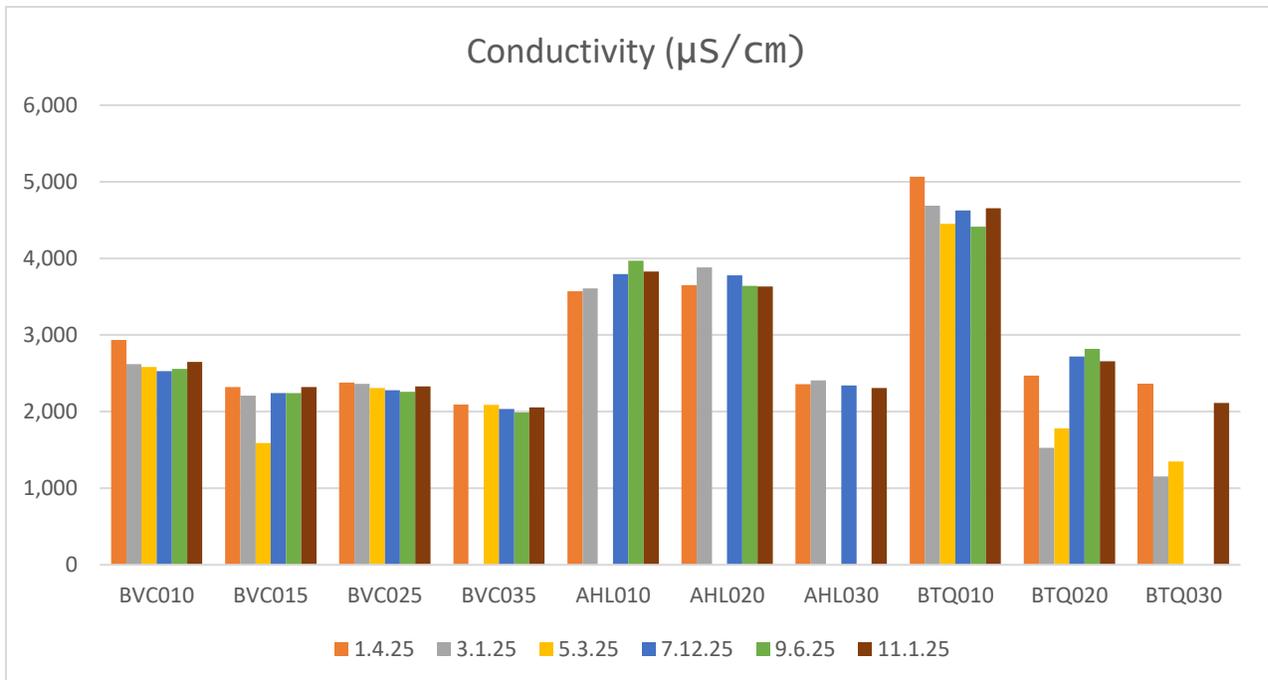


pH:

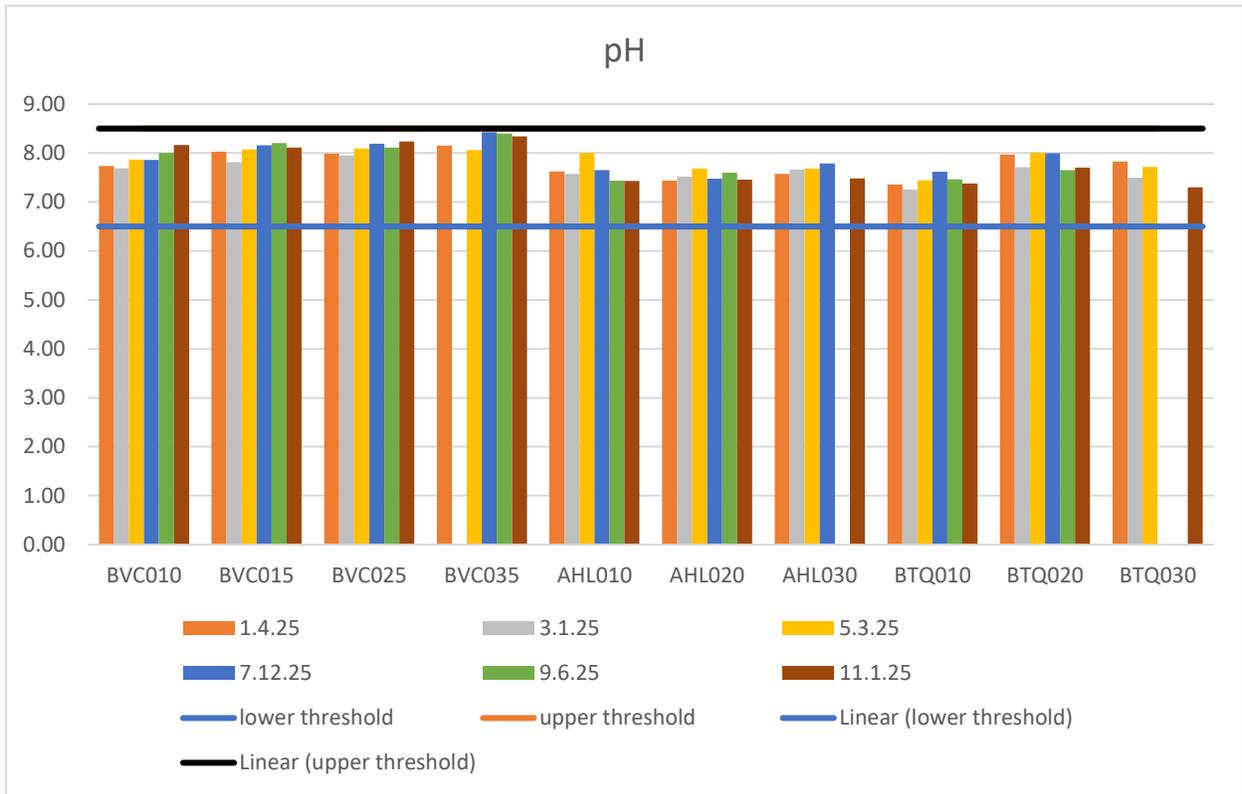


Turbidity:

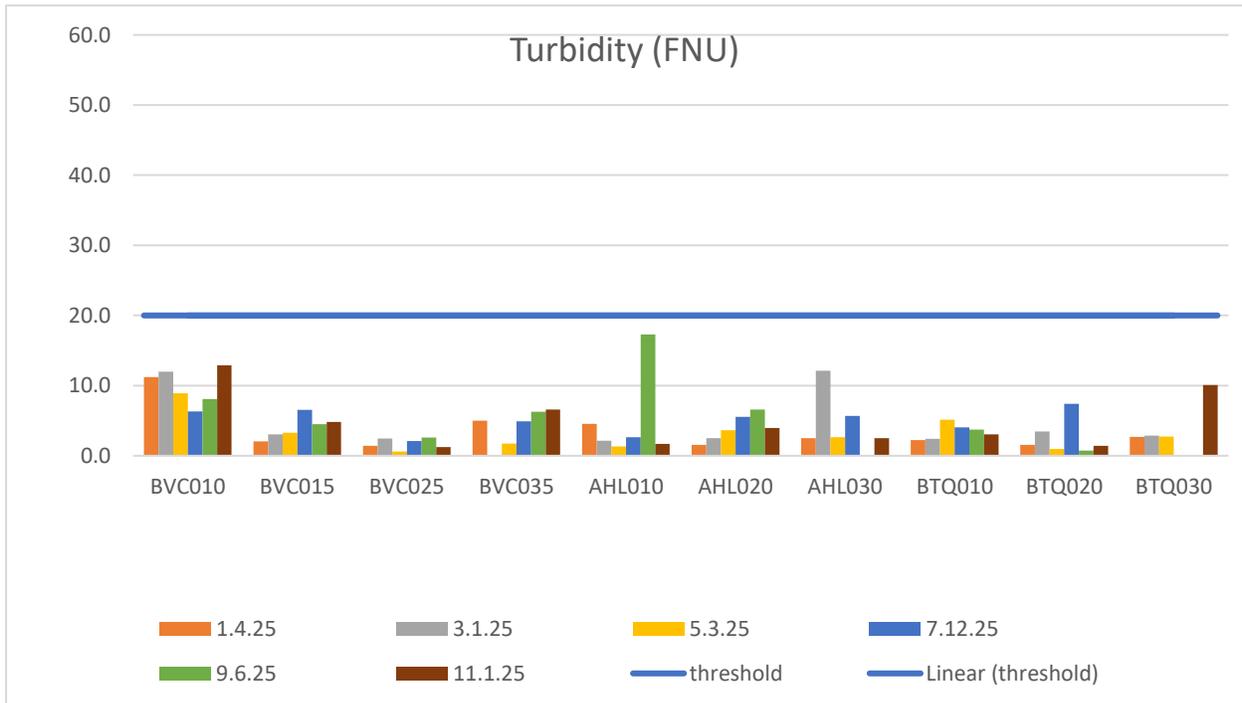


Total phosphorus:

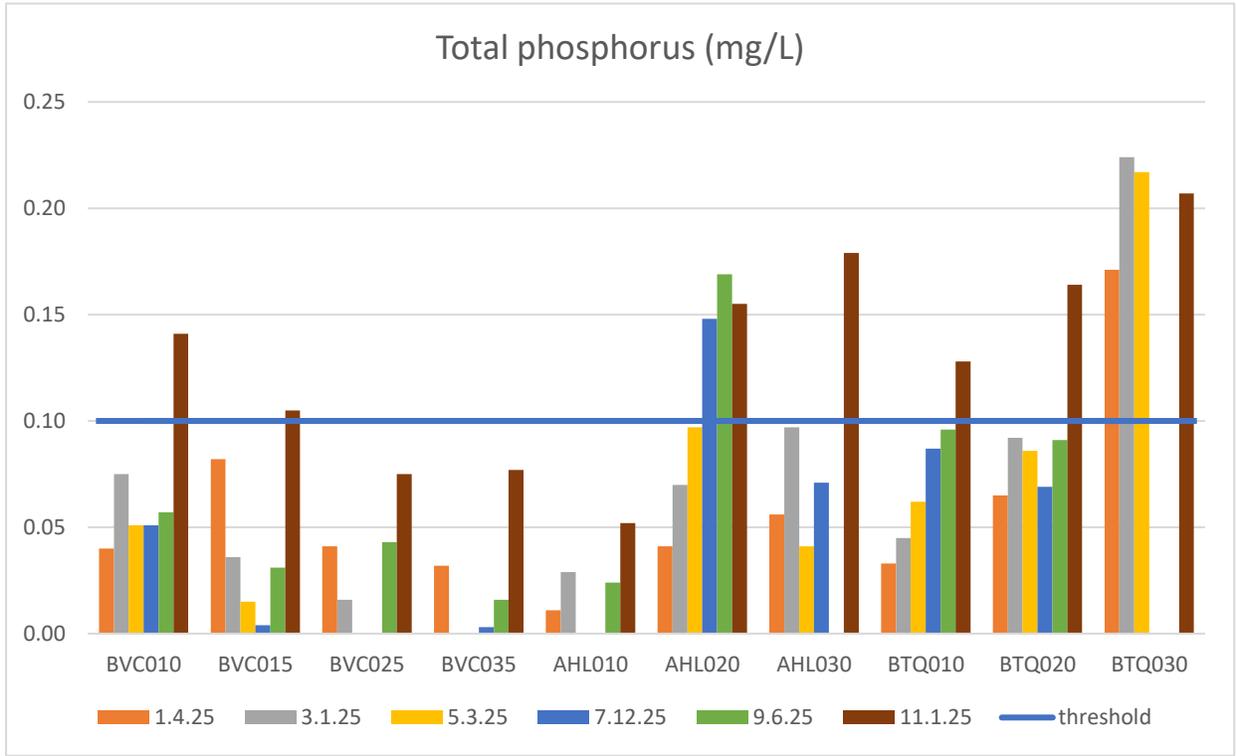


Reactive phosphorus:

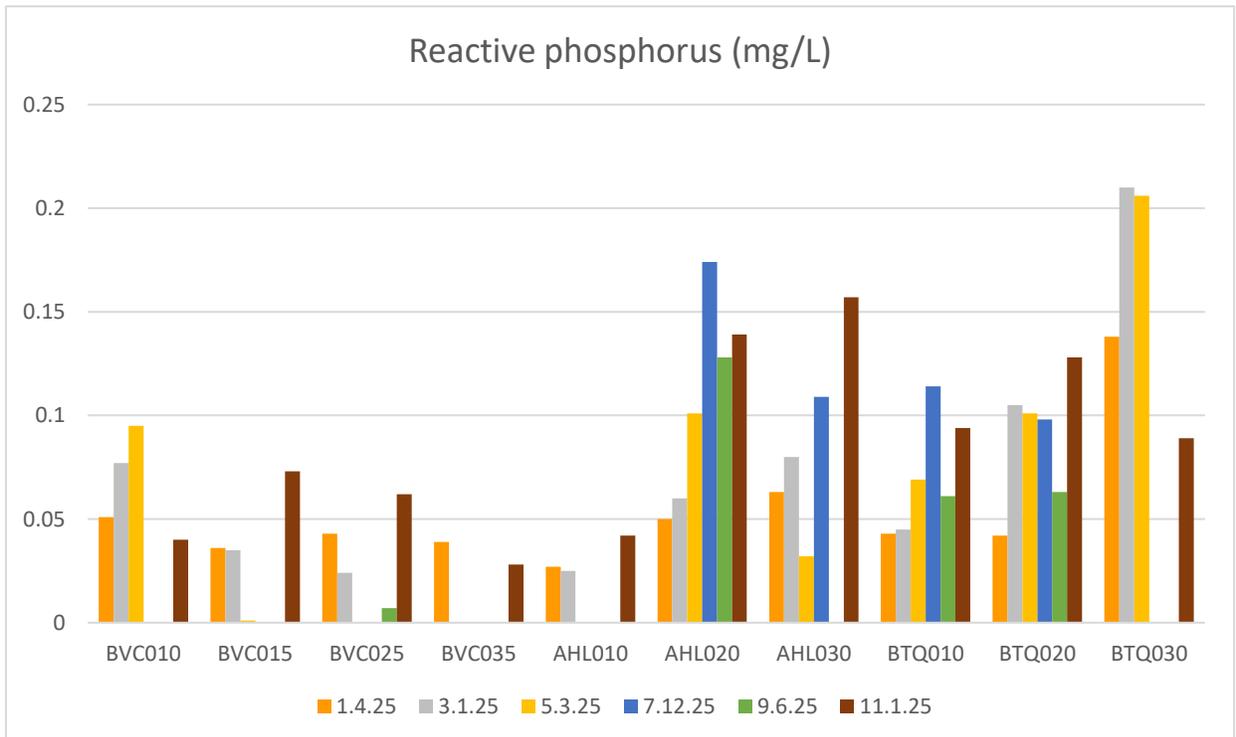

Nitrate:

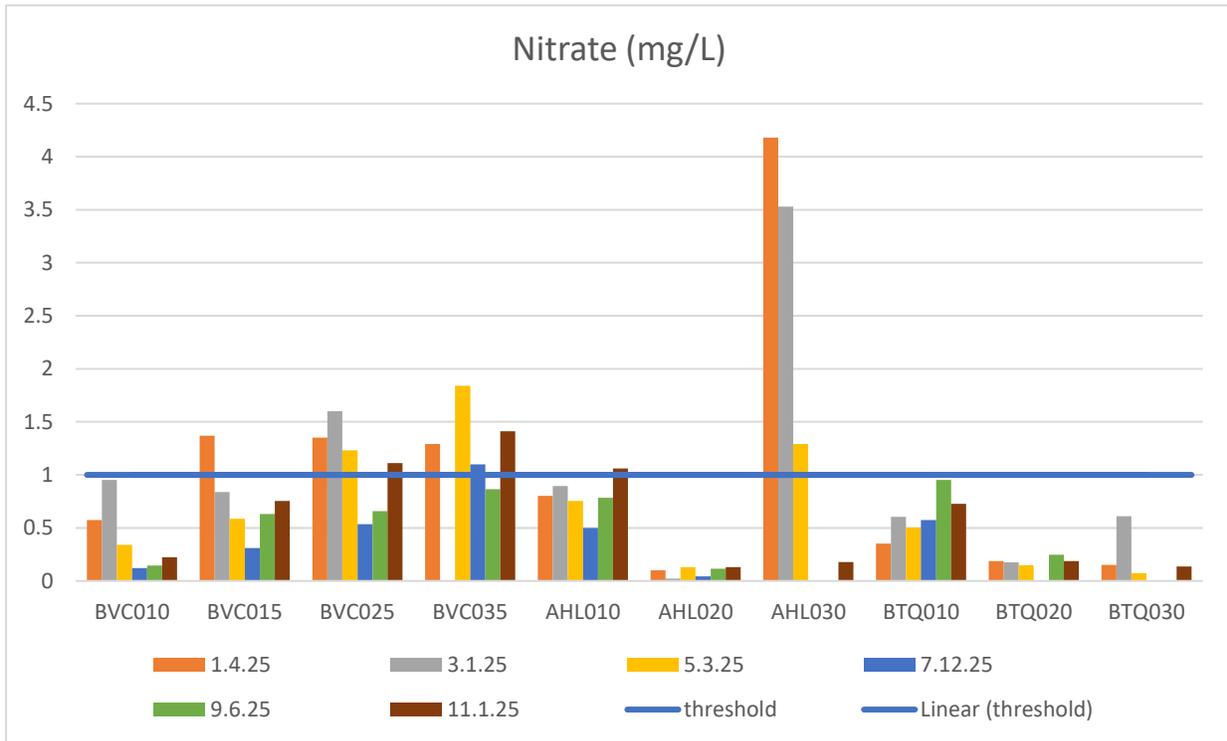

Ammonia:

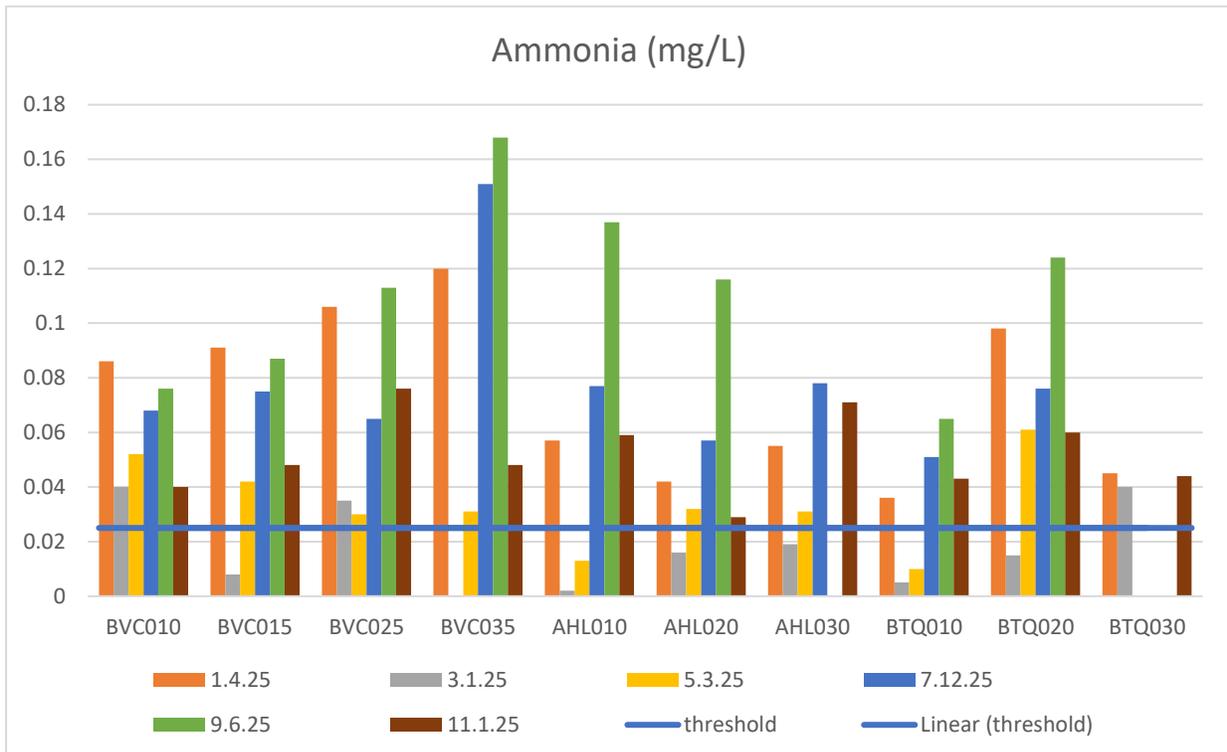

*E. coli*

