



JANUARY – JULY 2026 WATER QUALITY DATA

Dissolved oxygen

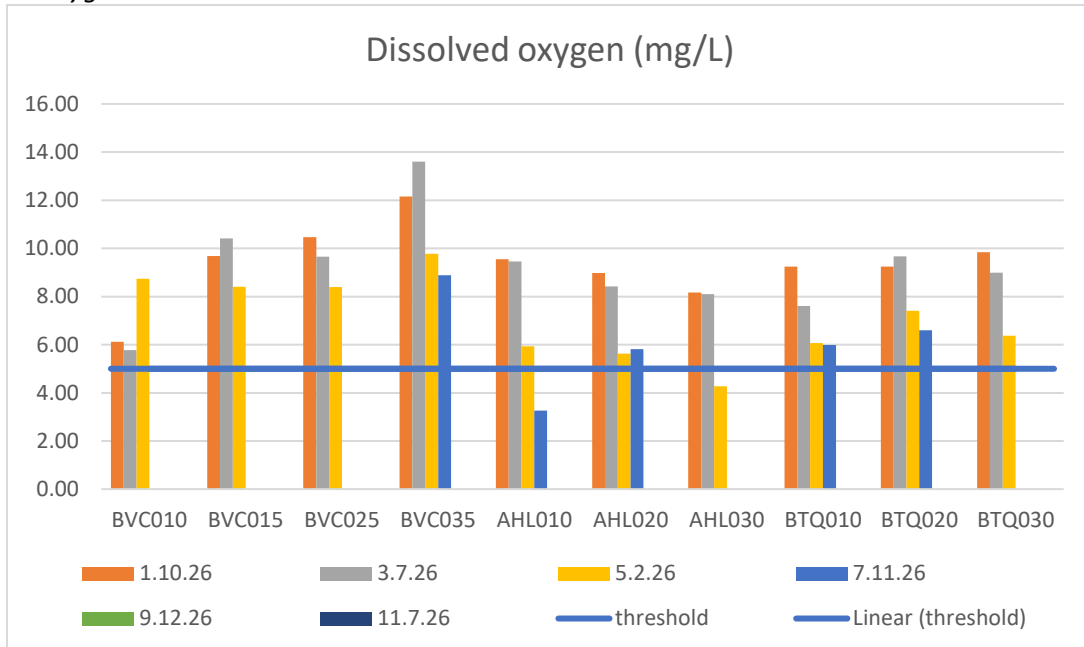


BVC field data inaccurate for some sites in July; AHL030 and BTQ030 dry in July


Conductivity

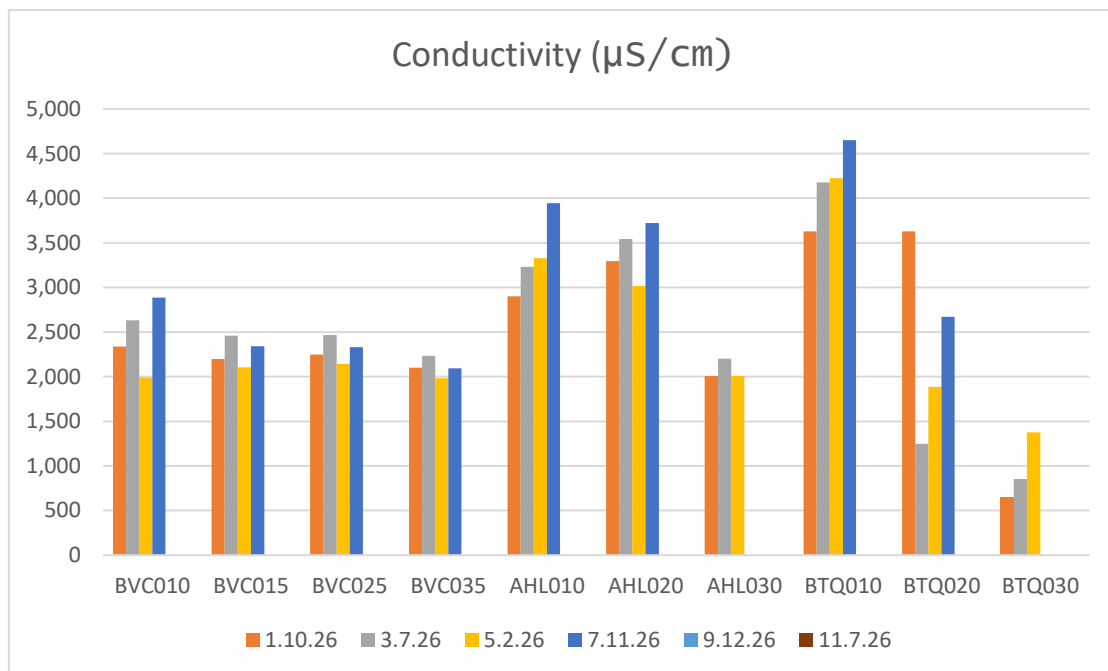


pH

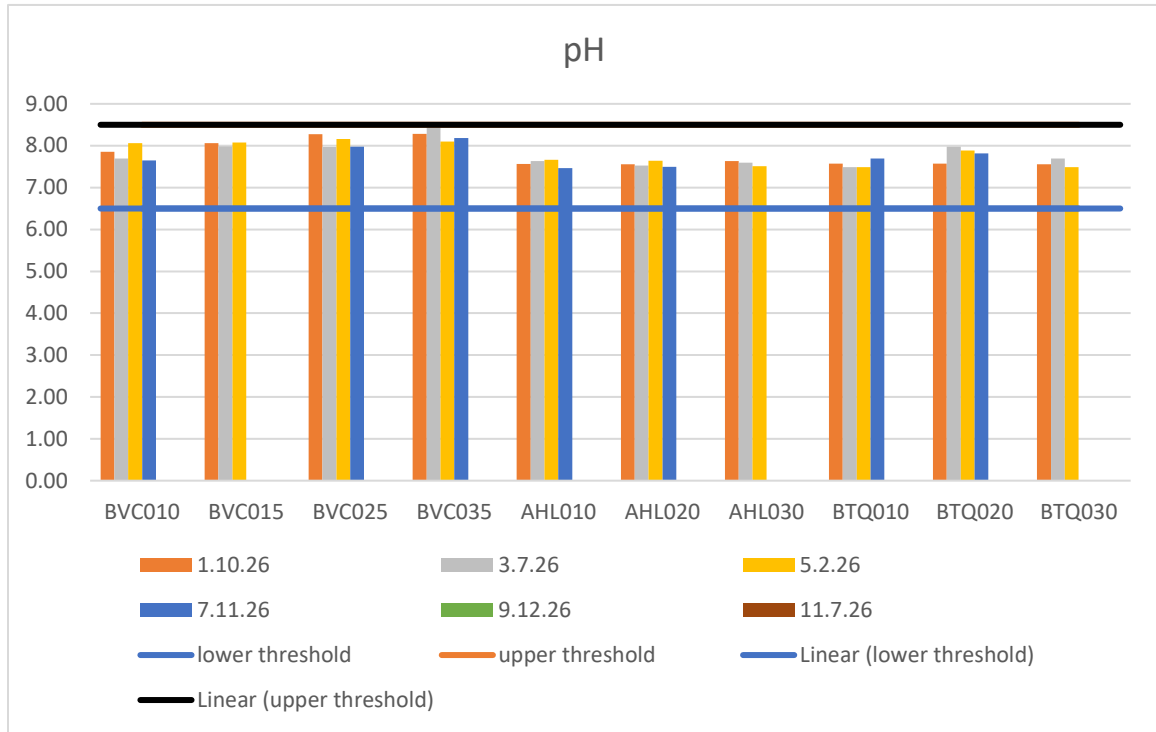


Turbidity

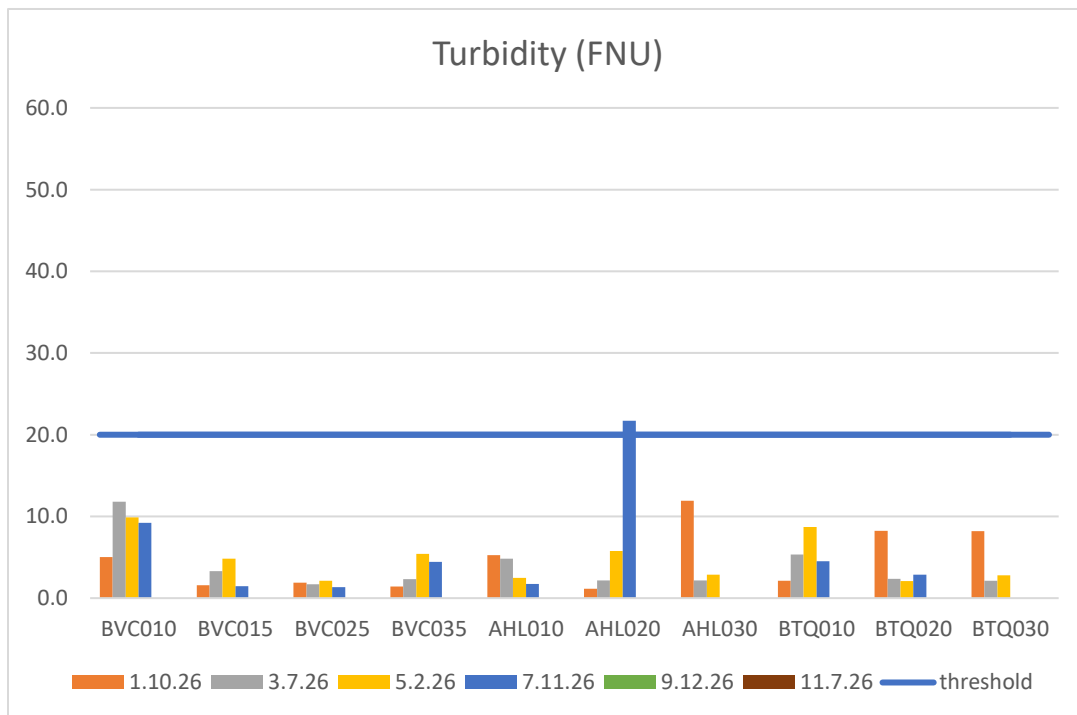


Total phosphorus

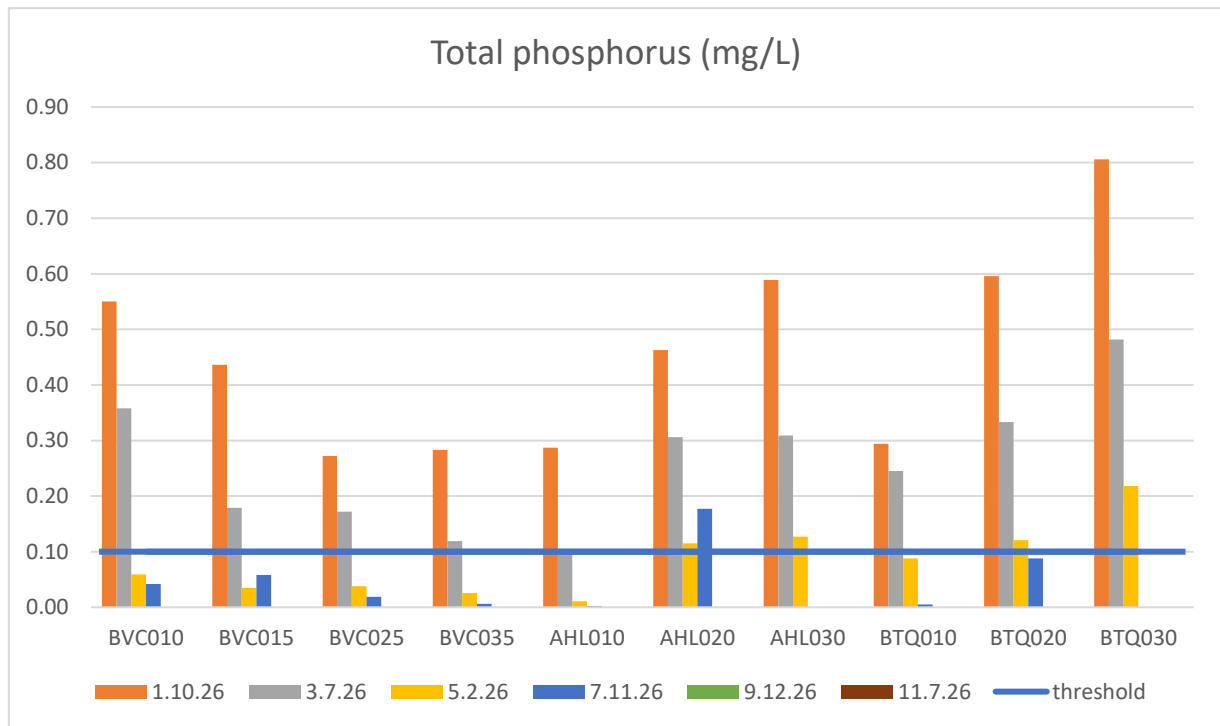


Reactive phosphorus

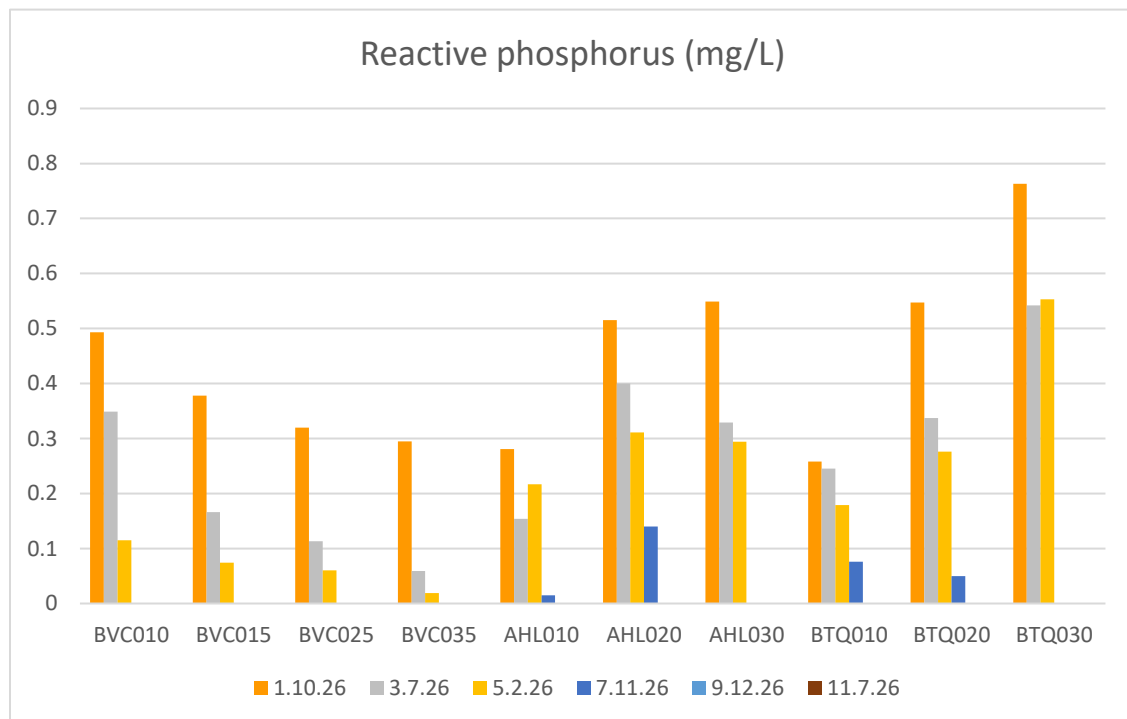

Nitrate

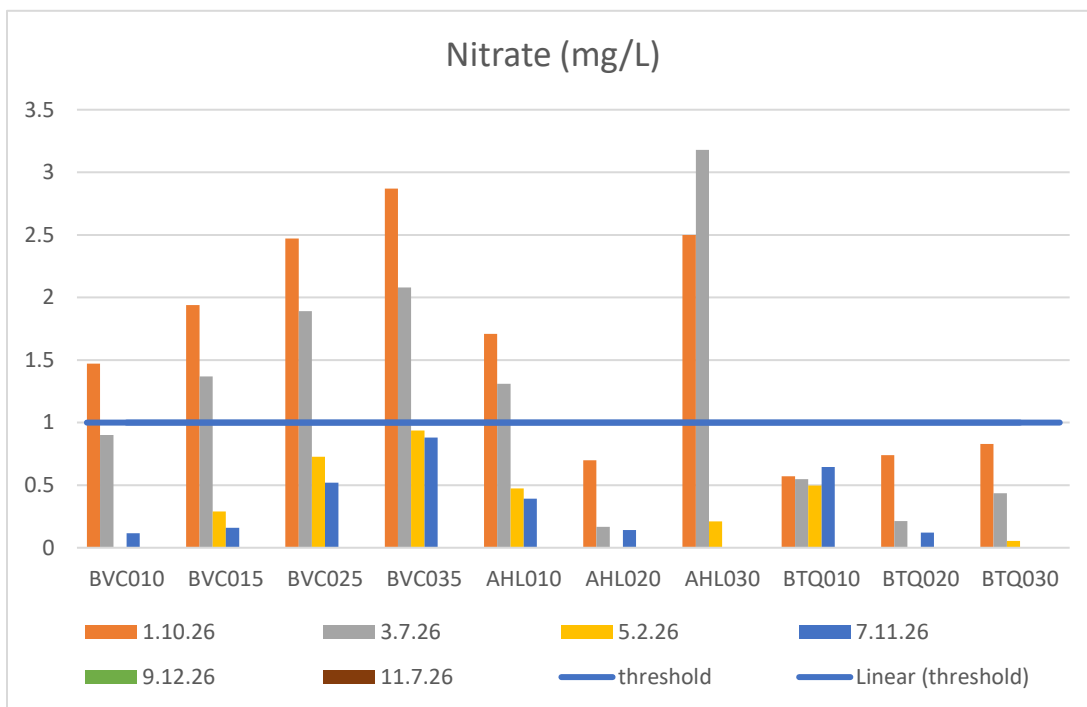

Ammonia

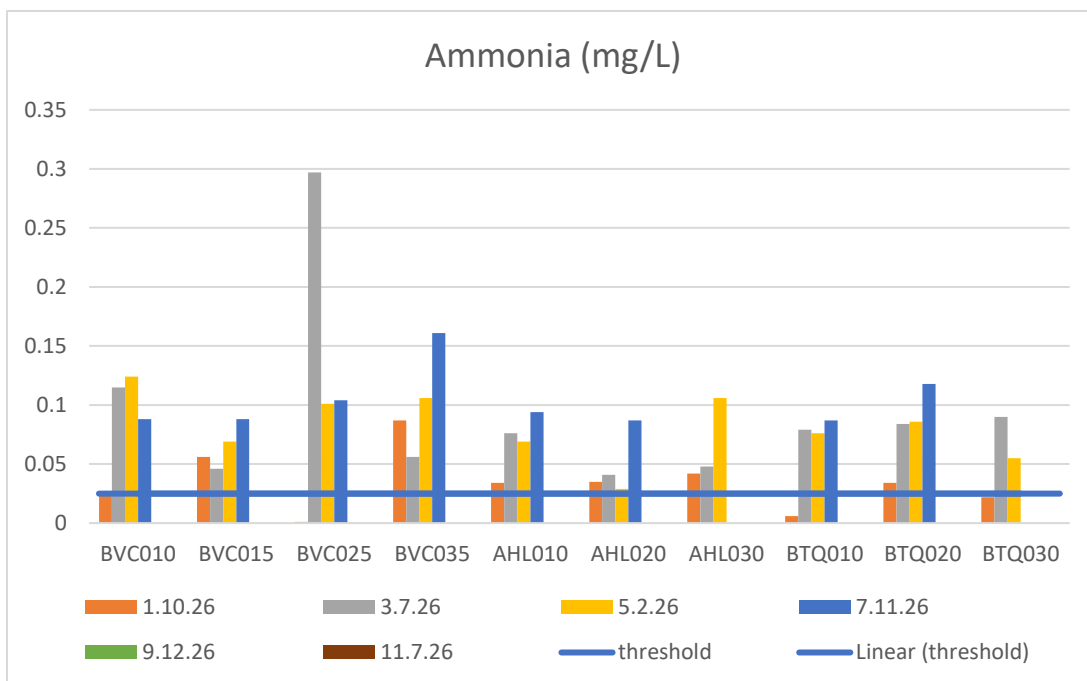

E. coli

